
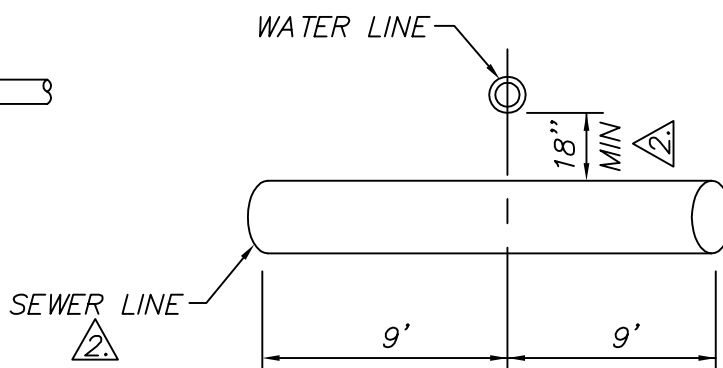


COMMON TRENCH
SECTION

SEPARATE TRENCH
SECTION

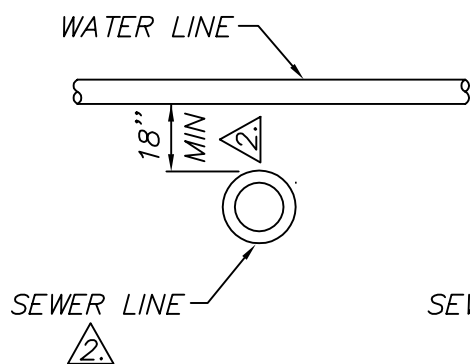

CROSSING DETAILS ③

NOTES:

- ① IF WATER LINE IS LOCATED 18" OR MORE ABOVE THE SEWER, THE DISTANCE BETWEEN LINES CAN BE REDUCED TO A MIN. OF 6 FEET.
- ② LESS THAN 18" CLEARANCE REQUIRES THE SEWER LINE TO BE SLEEVED WITH DUCTILE IRON PIPE OR BE ENCASED IN REINFORCED CONCRETE TO A LENGTH OF 9 FEET IN EITHER DIRECTION FROM THE WATER MAIN.
- ③ REFER TO STANDARD DETAIL DRAWING NO. 2-19 (306) FOR MORE SANITARY SEWER CROSSING CRITERIA.

| NO. | REVISION | DATE | STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION | SECTION |
|------------------|---------------|-------|--|----------------------------|
| 1 | REVISE NOTE 2 | 01/04 | TYPICAL SEWER UTILITY TRENCH | RENO |
| | | | | DRAWING NO. R-204 (306) |
| | | | | DATE 08/00 |
| | | | | PAGE 203 |
| APPROVED BY G.S. | | | 01/04 | |